


## HUDSON PUBLIC POWER - INDICE TOTALS

### Region 2

YEAR	Average System Availability ASAI	Customer Avg Inter Duration CAIDI	System Avg Inter Duration SAIDI	System Avg Inter Frequency SAIFI
2011	99.9914%	70.64	3.73	5.6167%
2012	99.9860%	75.35	6.14	8.5870%
<b>HPP AVERAGE</b>	<b>99.9887%</b>	<b>73.00 Minutes</b>	<b>4.94 Minutes</b>	<b>7.1019%</b>
<b>Region 2 Averages 2009 Survey</b>	99.9500%	91.35 Minutes	87.99 Minutes	106.0000%

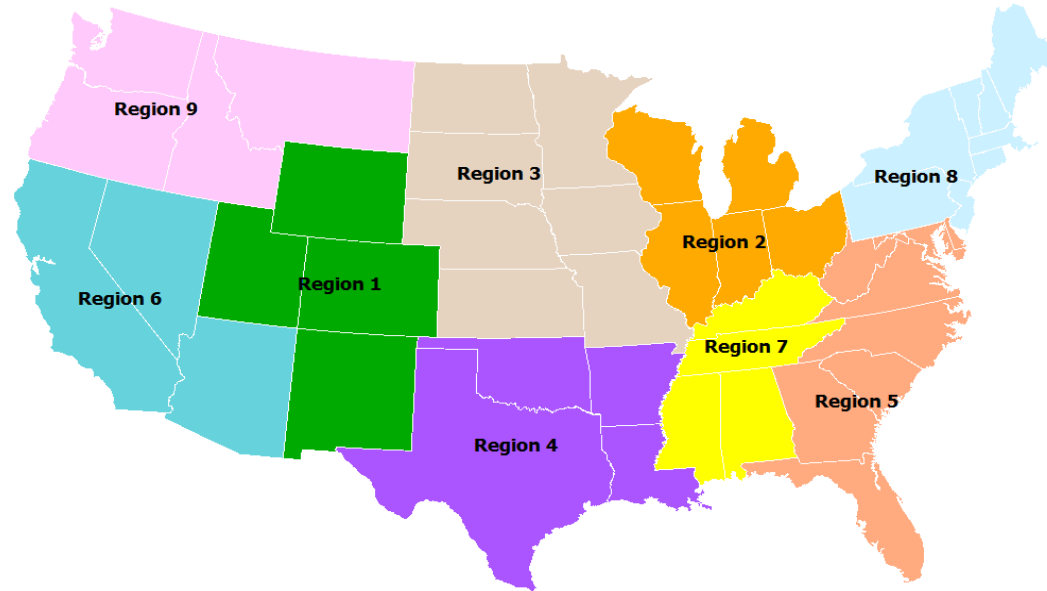

Note: To remain consistent with other utilities, indice totals do not include outages deemed beyond the control of the utility (ie. lost supply feed) nor do they include scheduled outages for routine maintenance work.