




PER ARB, EGRESS WINDOW WELLS SHOULD BE NO MORE THAN 6" ABOVE FINISHED GRADE

GAR:3 CAR SIDE LEFT W/9' BASEMENT



CERTIFY THAT THIS PLAN WAS PREPARED BY ME AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND

3-27-18 STAN R. LOCH P.E. #63332

5425 WARNER ROAD - SUITE 12 VALLEY VIEW, OHIO 44125 440-602-9071



ENGINEERING and SURVEYING

Civil Engineering Land Surveying

SHEET CONTENT

SITE PLAN

FOR**PULTE HOMES** SUBLOT 7 6766 MAJESTIC OAKS DRIVE IIV THERESERVE AT RIVER OAKS SUBDIVISION PH . SITUATED IN THE CITY OF HUDSON COUNTY OF SUMMIT


STATE OF OHIO


REVISIONS

NO.	DATE	DESC	RIPTION		BY
-				· ·	
-+					
		·#··			
HORIZ, SCALE			YER.	. SCALE	
	1" = 20'	·			

1" = 20'	
DRAWN BY	DATE
KEG	3-27-2018
CHECKED BY	DRAWING NO
SRL	20142977
JOB NO	<u>SHEET</u>
20142977	1 OF 1






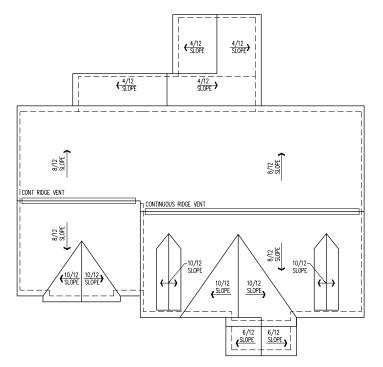

<u>ROOF PLAN</u>




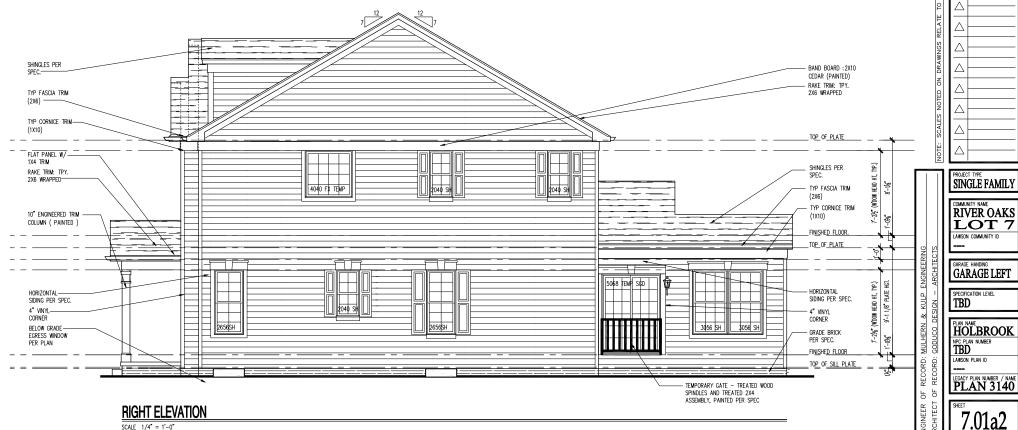

7.01a2

Front Elevation - 1 Side Elevations & Roof Plan

REV # DATE / DESCRIPTION

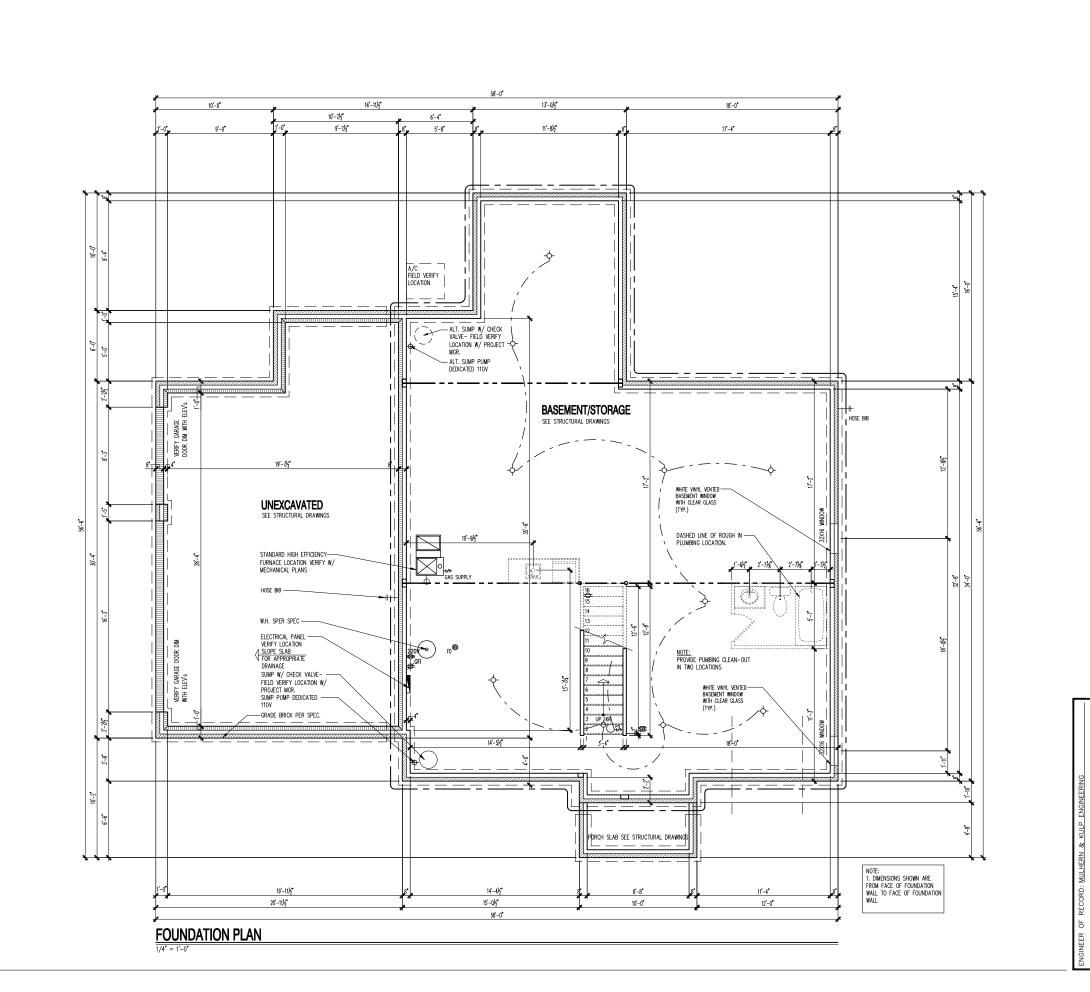

Pulte -

Full Basement Foundation Plan

PRODUCTION MANAGER
Jomey Heinzman
CURRENT
MELASE DATE: 03/21/2018
REV # DATE / DESCRIPTION
A

PROJECT TYPE
SINGLE FAMILY

RIVER OAKS
LOT 7

LAWSON COMMUNITY ID

GARAGE HANDING
GARAGE LEFT

SPECIFICATION LEVEL TBD

PLAN NAME
HOLBROOK
NPC PLAN NUMBER
TBD
LANSON PLAN ID

LAND PLAN ID
LEGACY PLAN 1140

PLAN 3140

1.30a

First Floor Plan PRODUCTION MANAGER
Jamey Heinzman
CURRENT
RELEASE DATE: 03/21/2018

REV # DATE / DESCRIPTION

PROJECT TYPE
SINGLE FAMILY

RIVER OAKS LOT 7 LAWSON COMMUNITY ID

GARAGE LEFT

TBD

PLAN NAME HOLBROOK NPC PLAN NUMBER

PLAN 3140

Second Floor Plan

PRODUCTION MANAGER
Jamey Heinzman
CURRENT
RELEASE DATE: 03/21/2018 REV # | DATE / DESCRIPTION

PROJECT TYPE SINGLE FAMILY RIVER OAKS LOT 7


GARAGE LEFT

TBD

PLAN NAME HOLBROOK NPC PLAN NUMBER

PLAN 3140

2.20a

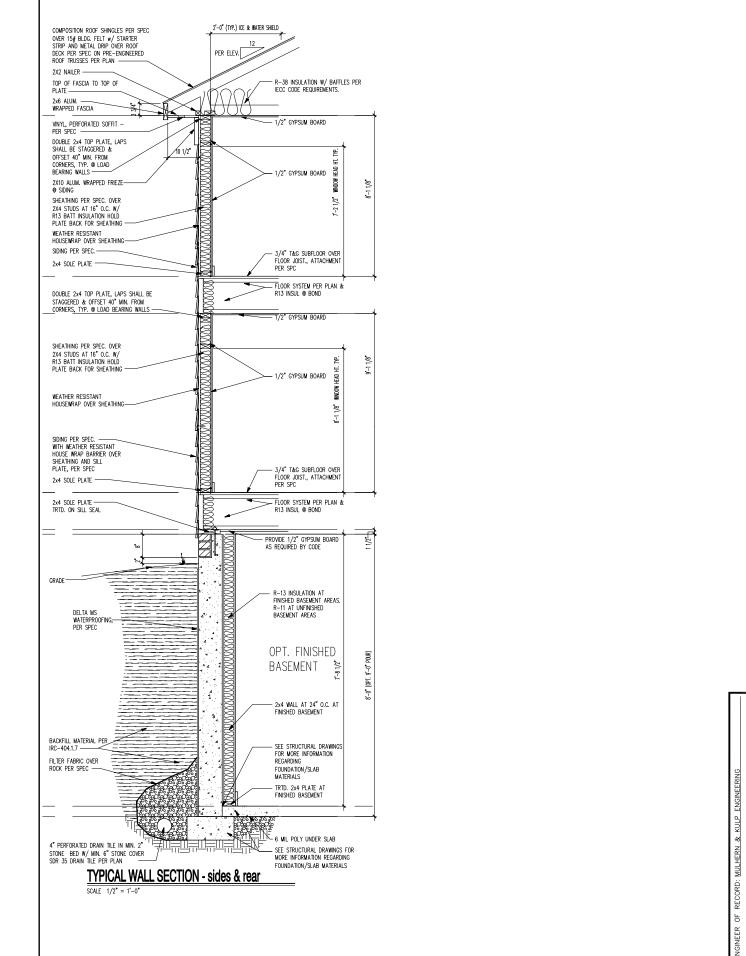

Typical Wall Sections

PRODUCTION MANAGER Jamey Heinzman CURRENT RELEASE DATE: 03/21/201 REV # | DATE / DESCRIPTION

SINGLE FAMILY


RIVER OAKS LOT 7

GARAGE LEFT

TBD HOLBROOK

NPC PLAN NUMBER PLAN 3140

3.31a

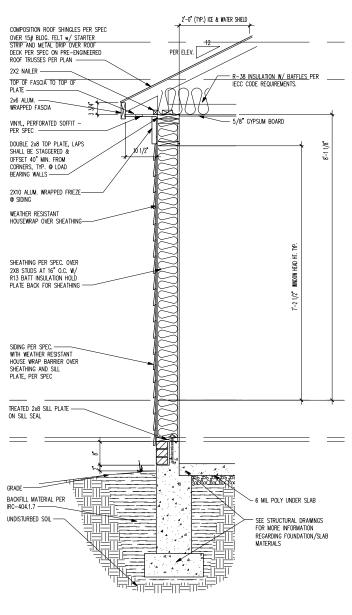

Cleveland Division
387 Medina Rd. Suite 1700
Medina, OH 44256 Typical Wall Sections PRODUCTION MANAGER
Jamey Heinzman
CURRENT
RELEASE DATE: 03/21/2018 REV # DATE / DESCRIPTION

PROJECT TYPE
SINGLE FAMILY

RIVER OAKS
LOT 7

LAWSON COMMUNITY ID
----

GARAGE LEFT

SPECIFICATION LEVE TBD

PLAN NAME
HOLBROOK

NPC PLAN NUMBER
TBD

LAWSON PLAN ID

LEGACY PLAN NUMBER / NAME PLAN 3140

3.31b

TYPICAL WALL SECTION - garage

SCALE 1/2" = 1'-



# OHIO DIVISION - LOT 7

# PLAN SHEET INDEX

SQUARE FOOTAGE INDEX:

AREA

1518 SQ, FT.

1786 SQ. FT.

2243 SQ. FT.

1417 SQ. FT.

DESCRIPTION OF AREA

TOTAL AREA UNDER ROOF

IRST FLOOR

NSI STAIR

SHT.	DESCRIPTION
0.00	COVER SHEET
1.30a 2.10a 2.11a 2.11b 2.11c 2.20a 3.30a 3.31a 3.31b AD 3.7 6.10 6.11	FULL BASEMENT FOUNDATION PLAN FIRST FLOOR PLAN PLAN DETAILS PLAN DETAILS PLAN DETAILS SECOND FLOOR PLAN TYPICAL BUILDING SECTIONS TYPICAL WALL SECTIONS TYPICAL WALL SECTIONS RICHITCHIVAL DETAILS FIRST FLOOR ELECTRICAL PLAN SECOND FLOOR ELECTRICAL PLAN SECOND FLOOR ELECTRICAL PLAN
7.01a1 7.01a2	FRONT ELEVATION "1" — FRONT AND REAR ELEVATIONS FRONT ELEVATION "1" — SIDE ELEVATIONS AND ROOF PLAN

# Clevel

and Division

Rd. Suite OH 442

'n				1	ŝ	II.
0	Ľ					
₫		PRODUCTION MANAGER				
ZE		Jamey Heinzman				
SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS		CURRENT RELEASE DATE: 03/21/2018				
Ⅎ	Ш					
2	Ш	KEV #	DATE /	DESC	KIPIIO	<u>N</u> _
0		$\wedge$				_
						_
F						
맆		$\triangle$				
œ						_
8						-
ź						_
Ϋ́		$I \wedge$				_
Δ						
8		_				
Ω		$\triangle$				_
뜯		_		_		_
ž		$  \wedge  $				_
ŝ						_
Ł						_
S		$\square$				
ij						
F		$\Box \land \Box$	_	_		_

# SINGLE FAMILY

RIVER OAKS LOT 7

GARAGE LEFT

TBD

HOLBROOK

TBD

LEGACY PLAN NUMBER / NAM PLAN 3140

# **HOLBROOK**

# 1 - GENERAL BUILDING & DESIGN REQUIREMENTS 1) THE ATTACHED PLANS & SPECIFICATIONS ARE THE SOLE PROPERTY OF PULTE HOMES INC. ANY UNAUTHORIZED USE OF THESE PLANS WITHOUT PRIOR WRITTEN CONSENT OF PULTE HOMES INC. IS STRICTLY PROHIBITED. 2) PULTE HOMES INC. DESIGNS & BUILDS HOUSING AS SET FORTH BY THE FORMAT AND PROVISIONS OF THE RESIDENTIAL CODE OF OHIO (RCO), AND THE NATIONAL ELECTRIC CODE (NEC). ANY NON-CONFORMING DOCUMENTS DISCOVERED BY THE CONTRACTOR OR HIS AGENTS SHALL BE CALLED TO THE IMMEDIATE ATTENTION OF PULTE HOMES

- 3) THESE PLANS ARE SUBJECT TO MODIFICATIONS TO MEET CODE REQUIREMENTS AND/OR TO FACILITATE
- 3) HESE PLANS ARE SUBSECT 10 MOURICATIONS TO MEET CODE REQUIRMENTS ANU/OR TO FACILITATE MECHANICAL/ ELECTRICAL PUBLISHING INSTALLATION AND/OR TO IMPREMENT DESIGN IMPROVEMENTS. ANY INTENTION TO MODIFY THESE PLANS MUST BE APPROVED IN WRITING BY PULTE HOMES INC.

  4) CONTRACTOR SHALL BE RESPONSIBLE FOR VERYINGS ALL BIOMENOUS AFFECTING CONTRACTOR'S PRODUCTS, INSTALLATIONS, OR FABRICATIONS IN THE FIELD PRIOR TO EXPEDITING THE CONSTRUCTION OF SUCH WORK FIELD WORK FIELD WORK FIELD AND BECOMING FAMILIAR WITH THE EXISTING CONDITIONS AND SCOPE OF WORK INCLUDING BUT NOT LIMITED TO SITE 4/0 (ROUND FAULT INTERRUPTS SHALL BE CARTED PER IN MANUFACTURER SPECIFICATIONS. AND SOIL BEARING CONDITIONS.
- ERRORS AND OMISSIONS WHICH MAY OCCUR IN THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT, IN WRITING, AND WRITTEN INSTRUCTION SHALL BE OBTAINED PRIOR TO PROCEEDING WITH CONSTRUCTION. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY ERRORS, DISCREPANCIES, OR OMISSIONS FOR WHICH THE CONTRACTOR FAILED TO NOTIFY THE ARCHITECT PRIOR TO CONSTRUCTION AND/OR FABRICATION OF THE WORK.

# 2 - SITE CONSTRUCTION

- SOIL BEARING CALCULATIONS BASED ON 2500 PSF MIN
- 2) BACK FILL SHALL BE FREE FROM VEGETATION AND CONSTRUCTION DEBRIS. 3) BACK FILL SHALL BE PLACED IN LIFTS AND COMPACTED IN SUCH A MANNER AS BACKFILL TO NOT DAMAGE THE OUNDATION WALLS OR ANY WATERPROOFING/ DAMPPROOFING MATERIALS.

## 3 - CONCRETE

- ALL CONCRETE EXPOSED TO EXTERIOR FLEMENTS SHOULD BE AIR ENTRAINED 4-6%
- 1) ALL CONCRETE EAPOSED TO EXTENDED ELEMENTS SHOULD BE AIR ENTRAINED 4-0-6.
  2) SLOPE ON DRIVE SHALE BE NO LESS THAN 2% OR 1/4" PER FOOT. PREFERABLY 4% OR 1/2" PER FOOT. THE
  FRONT STOOP SHALL HAVE SLOPE EQUAL TO 1" PER FOOT. THE RAISED WALK IN GARAGE SHALL HAVE A 1/2". PER FOOT SLOPE AND DRIVE SLAB SHALL BE SLOPED MIN. 1/4" PER FOOT.

  3) SOME COLUMN DIMENSIONS ARE FROM CENTER OF COLUMN TO EXTERIOR FACE OF BASEMENT WALL.
- ) BACK FILL SHALL BE FREE FROM VEGETATION AND CONSTRUCTION DEBRIS.
- 5) BACK FILL SHALL BE PLACED IN LIFTS AND COMPACTED IN SUCH A MANNER AS TO NOT DAMAGE THE FOUNDATION WALLS OR WATERPROOFING / DAMPPROOFING MATERIALS.
- FOUNDATION WALLS OR WATER-PRODFINS / DAMPTROUPING MALERALS.

  6) MUD SILLS SHALL BE TIREATED MEMBERS AND SECURED BY ANCHOR BOLTS AND/OR STRAPS AS SPECIFIED IN THE 1) ALL STUDS TO BE 2x4 SPF OR EQUAL UNLESS NOTED OTHERWISE.

  7) ALL STUDS TO BE 2x4 SPF OR EQUAL UNLESS NOTED OTHERWISE.

  2) USE DBL TOP PLATES 16" OC ON BOTH FIRST AND SECOND FLOOR AT ALL EXTERIOR AND LOAD BEARING.
- ) CALCULATIONS FOR COLUMN PADS BASED ON 2500 PSF SOIL BEARING.

# 4 - MASONRY

- ) ALL EXTERIOR BRICK MUST MEET ASTM C-216 FOR "SW" CONDITIONS
- ) MASONRY VENEER SHALL BE ATTACHED TO SUPPORTING WALLS w/ 22GA  $\times$  7/8" CORRUGATED METAL TIES AT
- 23 FLASHING BEHIND MASONRY SHALL BE 14# BUILDING PAPER OR FELT OR APPROVED EQUAL ATTACHED TO THE SHEATHING TO PREVENT MOSTUKE PENETRATION.
  4) WEEPHOLES SHALL BE PROVED ALONG THE OUTSIDE WYTHE OF EXTERIOR MASONRY WALLS AT 33" O.C. MAX,
- HALL BE A MIN. OF 3/16" IN DIAMETER, AND LOCATED IMMEDIATELY ABOVE THE FLASHING

### 5 - METALS

## 6 - WOOD AND PLASTICS

# 7 - THERMAL & MOISTURE PROTECTION

- 1) INSTALL FIRE STOPPING AND/O OR DRAFT STOPPING AS REQUIRED.
  2) ATTIC VENTILATION SHALL BE PROVIDED AT 1/150th OF THE AREA OF THE SPACE VENTILATED. CROSS VENTILATION WITH HALF OF THE VENTILATED AREA SHALL BE PROVIDED BY RIDGE OR GABLE VENTS AND THE OTHER HALF BY ZENE OF CORNICE VENTS. VENTS SHALL BE PLACED SO AS TO NOT ALLOW INFLITRATION OF RAIN OR SNOW.
  3) ALL 2x80 HEADERS TO BE \$2 UNILESS NOTED OTHERWISE.
  4) ALL 2x80 HEADERS TO BE \$2 UNILESS NOTED OTHERWISE.
  5) PROVIDE 1x BLOCKING UNDER ALL EXTERIOR SLIDING DOORS.
  6) ALL EXEMS & HEADERS SHALL HAVE A MINIMUM OF (1) 2x JACK STUD & (1) 2x KING STUD. THE NUMBER OF STUD AS AND ADDITIONAL BEAMS OF DRIVEN SHALL BY A PROVIDED IN THE NUMBER OF STUD AS AND ADDITIONAL BEAMS OF DRIVEN SHALL BY A PROVIDED AND ADDITIONAL
- 4) PROVIDE DEFINITION THE BOARD TOKE ALL SHOULD WARD DATH SHALL.

  4) PROVIDE DEFENEUD THE BOARD TOKE ALL SHOULD WARD DATH SHALL.

  5) ROOF VENTING TO BE PROVIDED AS SHOWN. SOFFIT, RIDGE, AND OTHER ROOF VENTS TO BE INSTALLED AS
- NOTED ON THE DRAWINGS & AS PER MANUFACTURERS RECOMMENDATIONS. 6) HOUSE WRAP & FLASHING TO BE INSTALLED PER PULTE BEST PRACTICES

# 8 - DOORS AND WINDOWS

- WINDOW CALL OUT PER WINDOW SCHEDULE VERIFY WINDOW MANUFACTURER WITH PROJECT MANAGER ) REVIEW ALL WINDOW HDR HEIGHTS PER PLATE HT. AND VERIFY W/ ELEVATIONS AND CORNICE DETAILS

- NJ CHARLOS THAN 5.7 SF.
  LEAR OPENING OF NOT LESS THAN 20" WIDE X 24" HIGH AND SHALL NOT BE MORE THAN 44" ABOVE THE
  LOOR.

# 15 - MECHANICALS

1) FACTORY BUILT CHIMNEYS AND FIREPLACES SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS, AND ARE SUBJECT TO MECHANICAL INSPECTION
 2) PROVIDE EXTERIOR AIR INTAKE FOR COMBUSTION AIR.

# 16 - ELECTRICAL

- 4) GROUND FAULT INTERRUPTS SHALL BE LOCATED PER THE NEC.
  5) ALL SWITCHES SHALL BE INSTALLED AT 3"-2" ABOVE FINISHED FLOOR TO CENTERLINE OF SWITCH UNLESS NOTED
- 6) ALL CONVENIENCE OUTLETS SHALL BE INSTALLED W/ CENTERLINE OF OUTLET LOCATED 1'-3" ABOVE FINISHED
- 7) ALL CONVENIENCE OUTLETS WITH SWITCHES TO BE SWITCH AT TOP ONLY 8) ALL EXTERIOR WALL BRACKET FIXTURES SHALL BE INSTALLED AT 5'-6" ABOVE ADJACENT DOOR SILL HEIGHT TO
- CÉNTERLINE OF FIXTURE 9) APPROVED SMOKE DETECTORS SHALL BE LOCATED ON EVERY STORY OF THE DWELLING UNIT AS PER CODE (SEE SHEET 6.XXX FOR LOCATIONS). WHERE MORE THAN ONE DETECTOR IS REQUIRED THEY SHALL BE INTERCONNECTED. POWER SOURCE SHALL BE BUILDING POWER w/ BATTERY BACKUP.

# GENERAL FRAMING SPECS AND CONSTRUCTION NOTES STAIRS:

- 1) THE MAXIMUM RISER HEIGHT SHALL BE 7 3/4 INCHES (210 MM) AND THE MINIMUM TREAD DEPTH SHALL BE 10
- 2) HANDRAILS HAVING MINIMUM AND MAXIMUM HEIGHTS OF .34 INCHES AND 38 INCHES SHALL BE PROVIDED ON A LEAST ONE SIDE OF STAIRWAYS
- Leas) une jobe of symmetrics (where present) shall be constructed per code

  4) All Required hand rails shall be continuos the full length of the stars w/2 or more risers from

  A point above the the 10P riser of a flight to a point above the lowest riser of the flight. Ends

  Shall be returned or shall terminate at Newel Posts or Safety Terminals. Handrails adjacent to a WALL SHALL HAVE A SPACE OF NOT LESS THAN 1.5" BETWEEN THE WALL AND HAND RAIL.

- CONDITIONS ALL OTHER PARTITION WALL USE SINGLE TOP PLATE 24"OC.

- ) STRUCTURAL FLOOR MEMBERS SHALL NOT BE CUT, BORED, OR NOTCHED IN EXCESS OF THE LIMITATIONS SPECIFIED PER CODE
- 2) THE ENDS OF EACH JOIST, BEAM, OR GIRDER SHALL HAVE NOT LESS THAN 1.5 INCHES (38MM) OF BEARING ON WOOD OR METAL AND NOT LESS THAN 3 INCHES (76MM) ON MASONRY OR CONCRETE OR AS OTHERWISE SPECIFIED PER CODE
- 3) ANY CONVENTIONAL FLOOR JOISTS SHOWN DOUBLED ON PLANS TO BE GLUED AT INSTALLATION AND NAILED W/ 4) SHOP DRAWINGS FOR ANY AND ALL ENGINEERED LUNBERT TO BE ASSEMBLED PER MANY. RECOMM.

  4) SHOP DRAWINGS FOR ANY AND ALL ENGINEERED FLOOR SYSTEMS TO BE SUBMITTED TO ARCHITECT TO REVIEW IN CONFORMANCE WITH THESE CONSTRUCTION DOCUMENTS. WHERE THE CONSTRUCTION DOCUMENTS DO NOT ADDRESS METHODOLOGY, CONTRACTOR TO BE BOUND TO PERFORM IN STRICT COMPLIANCE WITH MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS.

# FRAMING:

- 1) ALL FRAMING DIMENSIONS TO FACE OF MEMBER/SHEATING.
- 2) ALL BEARING HEADERS TO BE 2 X 8 #2 OR EQUAL UNLESS NOTED OTHERWISE.

  3) ALL 2x10 & 2x12 HEADERS TO BE DOUGLAS FIR LARCH (NORTH) #2 UNLESS NOTED OTHERWISE.

- 7) TWO-PLY CONVENTIONAL BEAMS TO BE FACE-HAILED W/2 ROWS 164 COMMON NAILS STAGEERED 616" O.C. UNLESS NOTED OTHERWISE, THREE-PLY CONVENTIONAL BEAMS TO BE MALED AS ABOVE FROM EACH SIDE. MULTIPLE PILES OF ENGREED LUBRES TO BE ASSET OF BER MANUE. RECOUNT.

  8) JOIST HANGERS, WHERE REQUIRED, SHALL BE USED WITHOUT ANGLES.
- ) INSTALL FIRE STOPPING AND/ OR DRAFT STOPPING AS REQUIRED.

- 1) HIP AND VALLEY RAFTERS SHALL BE SUPPORTED AT RIDGE DOWN TO BEARING PARTITION. CUT ENDS OF RAFTERS
- 2) REMPERD ALL WINDOW HIDR HEIGHTS PER PLATE HT. AND VERIFY W/ ELEVATIONS AND CORNICE DETAILS
  3) TEMPERED GLASS SHALL BE USED IN ALL HAZARDOUS AREAS
  4) FRONT DOOR WIDTH AS REQUIRED BY CODE
  5) GARAGE DOOR AS REQUIRED BY CODE
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A
  6) EMERGENCY SLEEPING ROOMS SHALL HAVE

- 2006 RESIDENTIAL CODE OF OHIO
- 2006 INTERNATIONAL MECHANICAL CODE
- 2006 INTERNATIONAL ENERGY CONSERVATION CODE
- 2008 NATIONAL FLECTRIC CODE

# LIGHT & VENT CALCULATIONS:

WINDOW DATA:

ARGON WITHOUT CRIDS

/4" LOW-E 270/CLEA

ARGON WITH GRIDS 3/4" LOW-E/270 CLEAR

ARGON WITHOUT CRIDS

3/4" LOW-E 270/CLEAF

ARGON WITH GRIDS

5/4" LOW-E 270/CLEA

ROOM	SQ. FT.	LIGHT REQ'D	LIGHT SUPP	VENT REQ'D	VENT SUPP	NOTES
PLAN CENTER	55	4.40	5.20	2.20	2.10	
KITCHEN/NOOK	325	26.00	64.94	13.00	31.62	
GATHERING	287	22.96	46.30	11.48	19.80	
POWDER ROOM	36	N/A	5.20	39.6	50.00	
DEN	123	9.84	46.30	4.92	19.80	
DINING ROOM	161	12.88	24.80	6.44	10.60	
OWNER'S SUITE	274	21.92	66.20	10.96	26.60	
OWNER'S BATHROOM	104	N/A	12.40	114.40	150	
TOILET ENCLOSURE	15	N/A	N/A	16.5	50	
BEDROOM 2	158	12.64	16.30	6.32	6.90	
BEDROOM 3	166	13.28	23.40	6.64	9.80	
BEDROOM 4	205	16.40	35.10	8.20	14.70	
BATH 2	60	N/A	N/A	66.00	100.00	
GAME ROOM	242	19.36	23.40	9.68	9.80	

SIMONTON WINDOWS PERFORMANCE DATA

U FACTOR

0.33

SLIDING GLASS DOORS

0.26

# APPLICABLE CODES:

